


Deako Simple Ventilation Timer Switch

Countdown timer and hourly ventilation Timer Switch

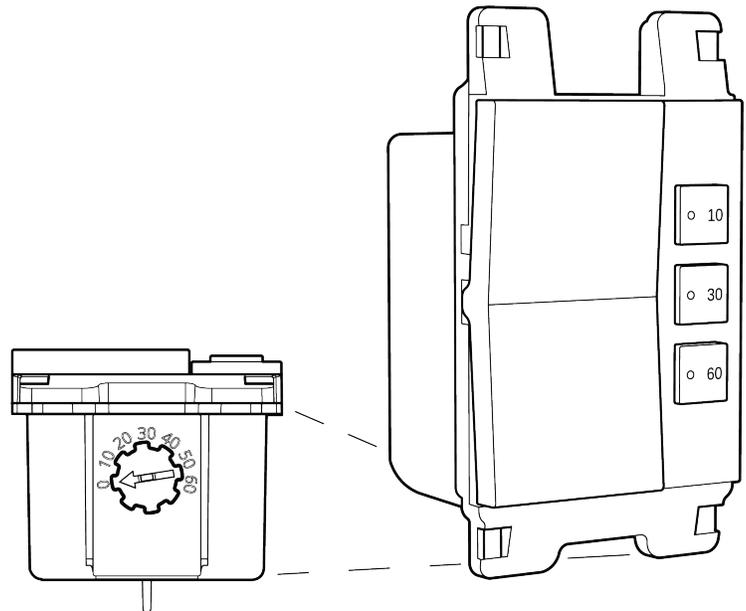

This Simple Ventilation Timer Switch is designed to monitor and control the operation of the bathroom exhaust fan and delivers a precise amount of fresh air ventilation throughout the day, automatically. Using the dial located on the bottom of the switch, the user can adjust the 'ventilation' setting.

The 'ventilation' setting allows the user to specify how many minutes per hour they want the fan to run, while the 3 countdown timer buttons specifies how many minutes the user wants the fan to run during normal use. Both of these setting help homeowners save energy and meet continuous ventilation codes, such as ASHRAE 62.2 and CalGreen Title 24.

Features

- Adjustable Ventilation Timer to ensure proper bathroom ventilation, expelling stale air to improve indoor air quality
- Three countdown timer options: 10 min, 30 min or 60 min; simply push the button to set countdown time preference
- Designed to meet ASHRAE 62.2, Energy Star and CalGreen Title 24 codes for continuous ventilation*
- Manual On/Off fan control
- Saves energy, countdown timer automatically turns the fan off

* when used with ASHRAE 62.2 compliant fans

Applications

Bathroom Exhaust Fans

Specifications

Compatibility	Single pole circuits
	Deako Faceplate DS-FP series
	Deako Backplate DS-BP series
	Neutral wire required
Regulatory approvals	cULus Listed TIMERS E482849
Supported currents & load types	INC/HAL 800W
	LED 120W
	¼ HP motor
Environment	Indoor use only
Operating temperature range	0°C to 40°C (32°F to 104°F)
Dimensions (H x W x D)	2.8" x 1.7" x 1.7"
Weight	2.6 oz
Color	White
Warranty	1-year
Vertical markets	Residential
	Multiple dwellings
	Hospitality / lodging

Also Available in the Deako Switch Family

- Simple Ceiling Fan Controller
- Simple Motion Switch
- Simple Dimmer
- Simple Night Light
- Simple Astronomical Timer
- Simple Bathroom Timer Switch
- Smart Switch
- Smart Dimmer
- Smart Plug

Date	Notes
Job location	
Approved by	
Job no. / type	